

# An Investigation of new Control method for MPPT in PV Array Using DC-DC buck boost Converter

**Amit Chouksey**  
 Assistant Prof. & Head  
 EC Dept. GRKIST Jabalpur M.P INDIA  
 Email:chouksey\_amit@yahoo.com

**Rajeev Shrivastava**  
 Assistant Professor  
 EC Dept. GRKIST Jabalpur M.P INDIA  
 Email:rajeev441220@yahoo.com

**Abstract:** - In this paper, solar radiation simulation using clearness index  $k_t$ , hour of day  $\omega_s$  and day of year  $n$  is studied. Daily distributions of solar radiation are presented for various clearness indexes  $k_t$ . additionally, taking into the studies about solar radiation, a photovoltaic array system and a DC/DC buck – boost converter are studied. Simulation of the whole system is presented focusing on DC/DC converter’s control strategy so that the system operates in maximum power point (MPP) and converter’s output voltage remains constant. Incremental conductance algorithm is used for maximum power point tracker (MPPT) implementation. A simplest method for controlling duty cycle  $D$  and photovoltaic array’s voltage by using a new variable  $d = D / (1-d)$  is proposed. Simulation results are shown and analyzed.

**Key-Words:** - MPPT, Photovoltaic array, Incremental conductance algorithm, solar radiation, DC/DC Converter

## Introduction

Recent years, due to big demand of electrical energy, extended research in electricity production from solar energy using Photovoltaic (PV) has been done. Basic advantage of these energy sources is the abundance of solar radiation in nature and environmental friendly way of electricity production. Although the high cost of PV panels and their low efficiency, big PV parks have been installed in recent years around the world. Research, also has been done in increasing PV’s efficiency and consequently maximizing output power. Furthermore, many papers have been published for PV’s coupling with varied loads and PV’s grid connection, using Power Electronics devices such as DC/DC converters and DC/AC single or three phase inverters [1], [2], [3], [4], [5]. For PV’s output power maximization many algorithms have been developed and improved [13], [14], [15], such as Incremental Conductance, Perturbation and Observation (P&O), Parasitic Capacitance and Constant Voltage and Current algorithm. The most usual of these algorithms above is the Incremental Conductance one. According to this method maximum power points are detected by comparing for each step the derivative of conductance with the instant conductance. Derivative of conductance and instant one can be calculated by sensing instant PV voltage and current values and using previous

## 2.DISTRUBUTION OF SOLAR RADIATION

Clearness index  $k_t$ , hour angle  $\omega_s$  and air mass  $m$  constitute basic parameters for solar radiation study and simulation. Air mass,  $m$ , will not be taken into account in this paper analysis. The clearness index probability density distribution can be constructed as a mixture [12] of two normal distributions, as shown below:

$$f(k_t) = \tau \cdot f_1(k_t) + (1-\tau) \cdot f_2(k_t) \quad (1)$$

Where  $f_1(k_t)$  and  $f_2(k_t)$  are density functions of normal random variables:

$$f_i(k_t) = (2 \cdot \pi \cdot \sigma_i^2)^{-0.5} \cdot \exp\left(\frac{-0.5 \cdot (k_t - \mu_i)^2}{\sigma_i^2}\right), \quad i=1,2$$

(2)

The “mixing factor”  $\tau$  is equal to:

$$\tau = \frac{(\overline{\mu_2} - \overline{k_t})}{(\overline{\mu_2} - \overline{\mu_1})} \quad (3)$$

Where  $\mu_1$  and  $\mu_2$  are the mean values of normal distributions  $f_1$  and  $f_2$  respectively and  $\overline{k_t}$  is the mean value of clearness index. The range of  $\tau$  values is  $0 < \tau < 1$ .

Clearness index  $k_t$  is defined as the ratio of solar radiation  $G$  to extraterrestrial radiation  $G_{ref}$  as shown in (4).

$$k_t = \frac{G}{G_{ref}} \quad (4)$$

Extraterrestrial solar radiation is given by equation (5) as shown below:

$$G_{ref} = G_{SC} \cdot \left[ 1 + 0.033 \cdot \cos\left(\frac{360 \cdot n}{365}\right) \right] \cdot (\cos \phi \cdot \cos \delta \cdot \cos \omega + \sin \phi \cdot \sin \delta) \quad (5)$$

Where:

$G_{SC} = 1367 \text{ W/m}^2$  is the solar constant

$\omega$  is the hour angle

$\phi$  is the latitude

$n$  is the day of the year ( $1 < n < 365$ )

$\delta$  is given by (6)

$$\delta = 23.45 \cdot \sin\left(360 \cdot \frac{284 + n}{365}\right) \quad (6)$$

Taking into account specific conditions for Simulation ( $\phi=41.08\theta$  and  $n=284$ , which refer to Xanthi, Greece and on October 11th respectively) and using Matlab/Simulink, figures 1 to 3 presents daily distribution of solar radiation for three different values of clearness index 0.4, 0.65 and 0.8 correspondingly.

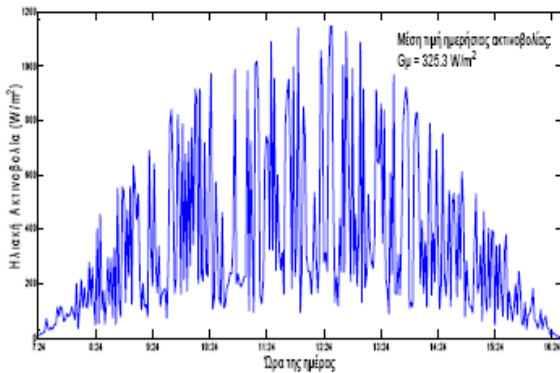


Fig.1 Daily solar radiation for kt=0.4.

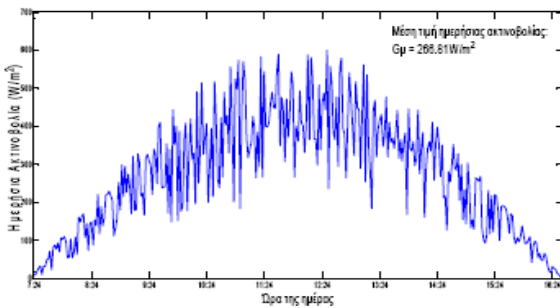


Fig.2 Daily solar radiation for kt=0.65.

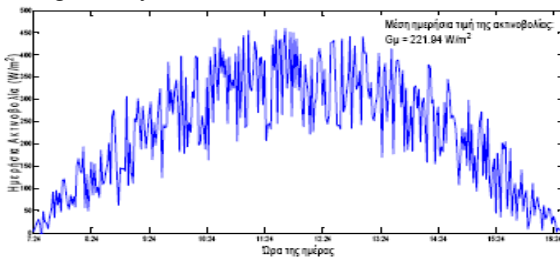


Fig.3 Daily solar radiation for kt=0.8.

### 3 Mathematical Model of PV

The simplest equivalent circuit of PV cells consists of a current source in parallel with a diode as shown in Fig. 4.

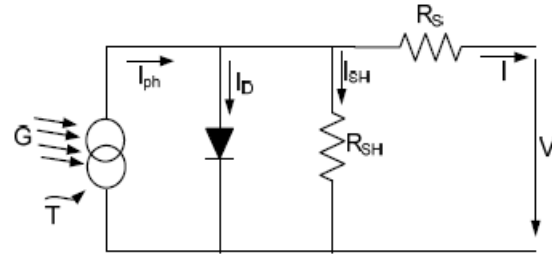


Fig. 4 Equivalent circuit of PV

Photo current  $I_{ph}$  is directly proportional to solar radiation  $G$ . Temperature  $T$  and photo current  $I_{ph}$  have a linear relationship according to equation (7), where  $I_{ph}(T_{ref})$  is the photo current which corresponds to reference temperature  $T_{ref}$ , and is equal to (8).  $K_o$  is a constant given by (9) and  $T$  is the temperature. In equation (8) and (9)  $G_{ref}$  is the nominal radiation given by PV's constructor  $I_{SC}$  is the short circuit current.

$$I_{ph} = I_{ph}(T_{ref}) \cdot \left( 1 + K_o \cdot (T - T_{ref}) \right) \quad (7)$$

$$I_{ph}(T_{ref}) = \frac{G}{G_{ref}} \cdot I_{SC}(T_{ref}) \quad (8)$$

$$K_o = \frac{I_{SC}(T) - I_{SC}(T_{ref})}{T - T_{ref}} \quad (9)$$

Diode's current is given by (10), where  $V$  and  $I$  are PV's output voltage and current correspondingly,  $I_o$  is saturation current of diode,  $V_T$  thermal voltage of it and  $R_S$  is in series resistance.

$$I_D = I_o \cdot \left[ \exp\left(\frac{V + I \cdot R_S}{V_T}\right) - 1 \right] \quad (10)$$

Current  $I_{SH}$  through shunt resistance  $R_{SH}$  according to Ohm's law is equal to:

$$I_{SH} = \frac{V + I \cdot R_S}{R_{SH}} \quad (11)$$

Taking into account equations (7) – (11) and applying Kirchhoff's current law, it results the  $I - V$  characteristic (12) for PV cell:

$$I = I_{ph} - I_o \cdot \left[ \exp\left(\frac{V + I \cdot R_S}{V_T}\right) - 1 \right] - \frac{V + I \cdot R_S}{R_{SH}} \quad (12)$$

Analyzing (12) for  $s$  PV panels in series and  $p$  in parallel and ignoring current through shunt resistance, equation (13) gives the general  $I - V$  characteristic for PVs. Equation (14) gives the output power of PV cells.

$$I = p \cdot I_{ph} - p \cdot I_o \cdot \left[ \exp \left( \frac{V + I \cdot \left( \frac{s}{p} \right) \cdot R_s}{s \cdot V_T} \right) - 1 \right] \quad (13)$$

$$P = V \cdot I \quad (14)$$

### 4 MPPT Algorithms

Incremental Conductance algorithm is based on differentiation of PV power to its voltage and on condition of zero slope of P – V curve in maximum power point (MPP). Especially, differencing PV power and replacing power with equation (14), arises equation (15).

$$\frac{dP}{dV} = \frac{d(V \cdot I)}{dV} = I \cdot \frac{dV}{dV} + V \cdot \frac{dI}{dV} = I + V \cdot \frac{dI}{dV} \quad (15)$$

From equation (15) and taking into account the basic condition of zero slope of P –V curve equation (16) is deduced.

$$\frac{dP}{dV} = 0 \Rightarrow I + V \cdot \frac{dI}{dV} = 0 \Rightarrow -\frac{I}{V} = \frac{dI}{dV} \quad (16)$$

-I/V represents the opposite of instant conductance of PV cells and dI/dV the incremental conductance. According to (16) these two quantities must be equal in MPP. Moreover, in the right of MPP is dI/dV < -

I/V, thus a reduction in PV’s voltage is essential to achieve MPP. Similarly, in the left of MPP is dI/dV > -I/V, thus an increase in PV’s voltage is essential to achieve MPP. These changes in PV’s voltage may be done by coupling a DC/DC

converter to PV and controlling properly its duty cycle, D. Most common used DC/DC converters in MPPT are the buck and boost, due to easy way of duty cycle control. In this paper is presented a tracker for MPP using a buck – boost DC/DC converter (fig. 5) which is able to operate in a wide range of output voltages and different loads demands. Equation (17) gives the basic relationship between input and output voltage of this converter.

$$V_{out} = \frac{D}{1 - D} \cdot V_{in} \quad (17)$$

As shown of (17), duty cycle is not support directly a linear relationship between Vout and Vin. This means that a linear change in duty cycle D, will not imply for example a linear change of Vin for keeping Vout constant.

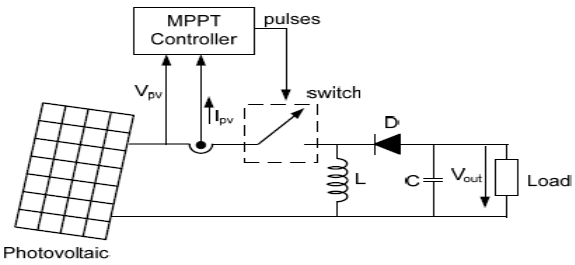


Fig. 5 Buck Boost DC/DC converter using for MPPT  
Thus, in this paper is proposed an alternative way of PV’s voltage control for achieving MPP. A new variable is defined as shown in (18).

$$d = \frac{D}{1 - D} \quad (18)$$

By using this new variable, d there is a linear relationship between the two voltages. So, in algorithm implementation using Matlab/Simulink, it is essential to control and change only d and not the actual duty cycle, D.

Flow chart in fig. 6 shows the whole operation of Incremental Conductance algorithm. In each algorithm cycle, d is calculated using the instant value of duty cycle, D and after this d is changed properly. Finally, new value of D is calculated again using the new value of ratio d and switch is driven.

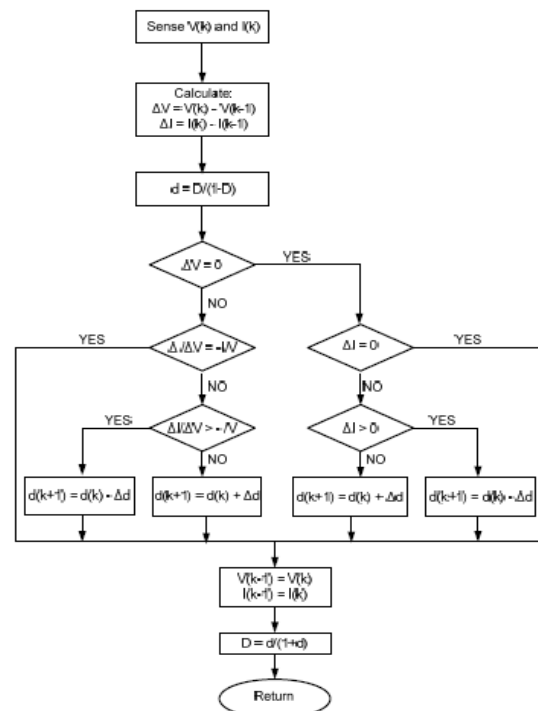


Fig. 6 Flow Chart of the MPPT algorithm

### 5 Simulation Results

For whole system simulation is used Matlab/Simulink and especially SimPowerSystems Toolbox. Before system implementation it is necessary to calculate the appropriate values of inductor and capacitor, by using equations (19) and (20), on condition of non – intermittent inductor current and capacitor voltage ripple vary in particular limits.

$$\frac{\Delta V_o}{V_o} = \frac{D \cdot T}{R \cdot C} = \frac{D}{R \cdot C \cdot f} \quad (19)$$

$$L_{min} = \frac{R}{2 \cdot f} \cdot (1 - D)^2 \quad (20)$$

Making use of these two equations, driving the switch with a frequency of 20 KHz and taking into account a percent of tolerance, these values were calculated as follows:  $L = 330\mu\text{H}$  and  $C = 220\mu\text{F}$ . The whole system simulation has been done for a gradual change of solar radiation from 400 W/m<sup>2</sup> to 500 W/m<sup>2</sup>, as shown in fig. 7.

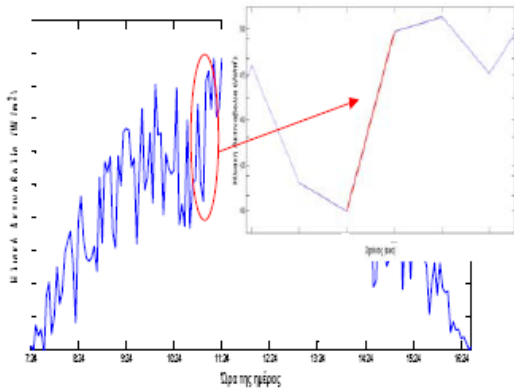


Fig. 7 Gradual change of solar radiation from 400 W/m<sup>2</sup> to 500 W/m<sup>2</sup>, using for system simulation.

Taking into account three different values of d change,  $\Delta d$  ( $\Delta d = 0.0005, 0.001$  and  $0.01$ ), and keeping the sampling time for A/D converters, which measure instant values of voltage and current, constant and equal to 0.5 ms, figures 8 to 10 presents MPPT’s operation.

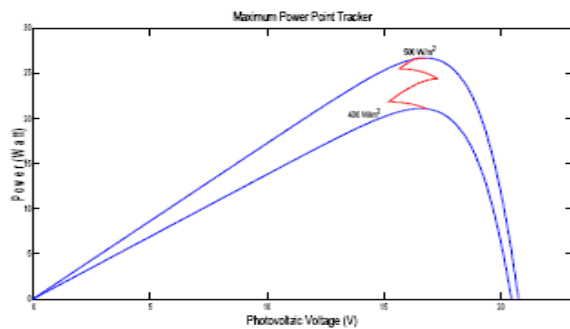


Fig. 8 MPPT’s operation for  $\Delta d = 0.0005$  for a gradual solar radiation change and sampling time 0.5 ms.

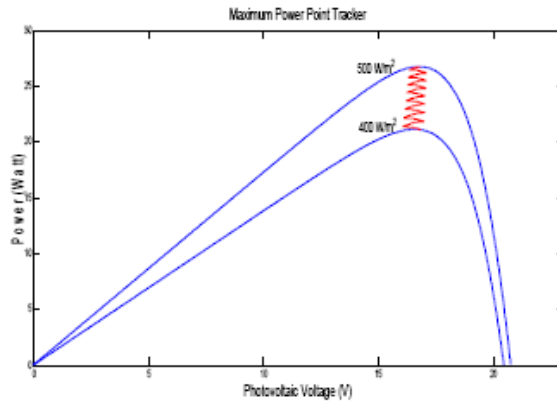


Fig. 9 MPPT’s operation for  $\Delta d = 0.001$  for a gradual solar radiation change and sampling time 0.5 ms.

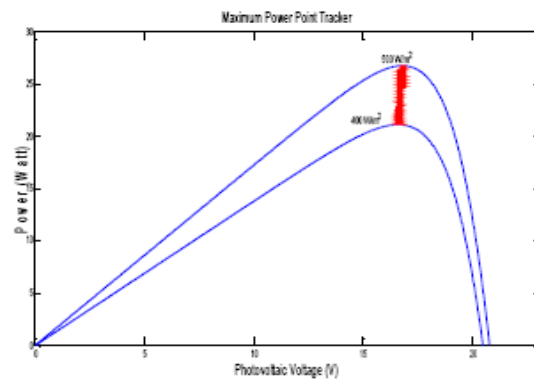


Fig. 10 MPPT’s operation for  $\Delta d = 0.01$  for a gradual solar radiation change and sampling time 0.5 ms. Figure 11 shows a comparison between MPPT’s operation for the three different variations,  $\Delta d$ .

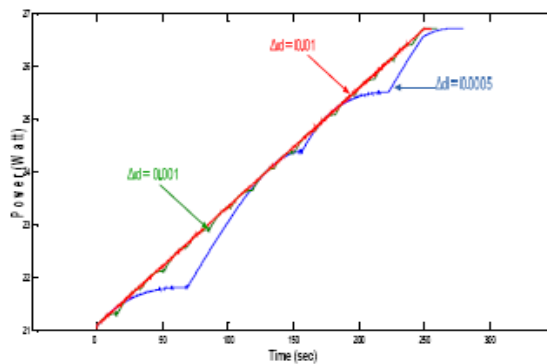


Fig. 11 Comparison between tracker’s operation for different  $\Delta d$  variations.

From fig. 11 is shown that the bigger  $\Delta d$  variation is used, the more linear operation of tracker occurs. Especially for very small values of  $\Delta d$ , such as  $\Delta d = 0.0005$ , extensive ripple is existed, which is undesirable. Furthermore, simulation of the

system has been done for different sampling times (TS = 0.5ms, 1ms and 2.5ms) for A/D converters with constant variation  $\Delta d$ .  $\Delta d$  is taken equal to 0.001, due to the fact that this value of  $\Delta d$  variation gives a small ripple as shown with green color in fig. 11. Figures 12 and 13 present simulation results for conditions quoted above. Curve for TS = 0.5ms and  $\Delta d = 0.001$  is the same as fig. 9.

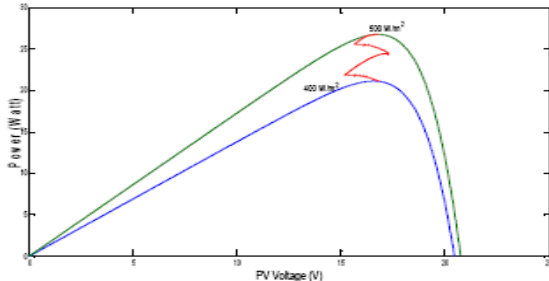


Fig. 12 MPPT's operation for TS = 1ms for a gradual solar radiation change as shown in fig. 7 and  $\Delta d = 0.001$ .

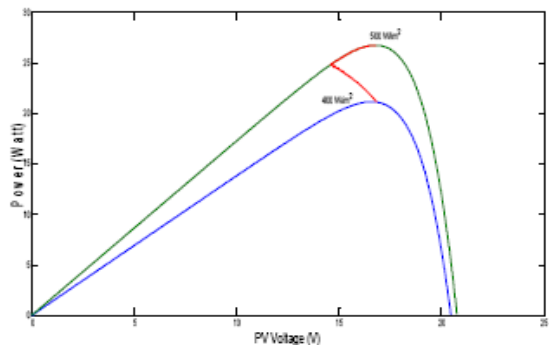


Fig. 13 MPPT's operation for TS = 2.5ms for a gradual solar radiation change as shown in fig. 7 and  $\Delta d = 0.001$ .

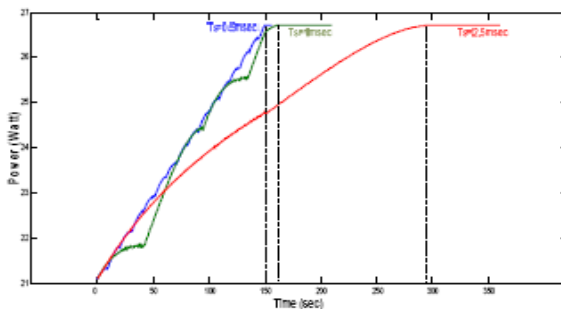


Fig.14 Comparison between tracker's operation for different sampling times TS for A/D converters.

A comparison study between three different sampling time conditions with constant variation  $\Delta d$ , is resulted figure 14. In this figure is shown the big difference in time for achieving MPP. Especially, the red line represents sampling time 2.5 ms and the time for achieving MPP is far bigger than the other two cases. Operation for achieving MPP for TS = 0.5 ms and TS = 1 ms (blue and green lines in fig.14) needs about the same time, but operation for TS = 1 ms occurs some ripple.

## 6 Conclusions

From this paper is concluded that it is necessary to occur a linear variation  $\Delta d$  of  $d$  and not of  $D$  (Duty Cycle). Moreover, it is proved that according to a gradual change of solar radiation, as variation  $\Delta d$  is increased, the maximum power point approach is getting smoother. Moreover, a small sampling time for measuring voltage and current of PV is necessary for reducing MPP's achieving time. Generally, it is essential to make an appropriate choice for variation  $\Delta d$  and sampling time TS of A/D channels. Thus, undesirable ripples during MPPT's operation will be eliminated and MPP will be achieved faster.

## References:

- [1] Henry Shu-Hung Chung, K. K. Ron Hui, C. M. Mok, M. T. Ho, "A novel Maximum Power Point Tracking Tecnique for Solar Panels Using a SEPIC or Cuk Converter", *IEEE Transactions on Power Electronics*, Vol. 18, No. 3, May 2003.
- [2] Toshihiko Noguchi, Shigenori Togashi, Ryo Nakamoto, "Short-Current Pulse-Based Maximum-Power-Point Tracking Method for Multiple Photovoltaic-and-Converter Module System" *IEEE Transactions on Industrial Electronics*, Vol. 49, No. 1, February 2002.
- [3] Eugene V. Solodivnik, Shengyi Liu, Roger A. Dougal, "Power Controller Design for Maximum Power Tracking in Solar Installations" *IEEE Transactions on Power Electronics*, Vol. 19, No. 5, September 2004.
- [4] Eftichios Kountroulis, Kostas Kalaitzakis, Nicholas Voulgaris, "Development of a Microcontroller-Based, Photovoltaic Maximum Power Point Tracking Control System" *IEEE Transactions on Power Electronics*, Vol. 16, No. 1, January 2001.
- [5] Benjamin Sahan, Antonio Notholt-Vergara, Alfred Engler, Peter Zacharias, "Development of a Single Stage Three-Phase PV Module Integrated Converter" *EPE 2007, 12th European Conference on Power Electronics and Application*, Aalborg
- [6] Sachin Jain, Vivek Agarwal, "A New Algorithm for Rapid Tracking of Approximate Maximum Power Point in Photovoltaic Systems", *IEEE Power Electronics Letters*, Vol. 2, No. 1, March 2004.
- [7] Yaow-Ming Chen, Yuan-Chuan Liu, Feng-Yu Wu, "Multiinput Converter With Power Factor Correction, Maximum Power Point Tracking, and Ripple-Free Input Currents", *IEEE Transactions on Power Electronics*, Vol. 19, No. 1, March 2004.
- [8] Kazutaka Itako, Takeaki Mori, "A Single Sensor Type MPPT Control Method for PV Generation System", *EPE 2007, 12th European Conference on Power Electronics and Application*, Aalborg
- [9] Ryosuke Utsumi, Shigeo Masukawa, Shiji Iida, "Photovoltaic Power System with Simplified Cascade Boost Choppers" *EPE 2007, 12th European Conference on Power Electronics and Application*, Aalborg.
- [10] Chee Wei Tam, Tim C. Green, Carlos A. Hernandez, "A Current Mode Controlled Maximum Power Point Tracking Converter for Building Integrated Photovoltaics" *EPE 2007, 12th European Conference on Power Electronics and Application*, Aalborg
- [11] T. Kerekes, R. Teodorescu, C. Klumpner, M. Sumner, D. Florica, P. Rodriguez, "Evaluation of Three-phase Transformerless Photovoltaic Inverter Topologies" *EPE 2007, 12th European Conference on Power Electronics and Application*, Aalborg
- [12] M. Jurado, J.M. Caridad and V. Ruiz, "Statistical distribution of the clearness index with radiation data integrated over five minutes intervals", *Solar Energy*, Vol.55, No.6, 1995, pp. 469-473.
- [13] D. P. Hohm and M. E. Ropp, "Comparative study of maximum power point tracking algorithms", *Progress in Photovoltaics: Research and Applications*, April 2003, 11: pp. 47-62
- [14] K. K. Tse, Billy M. T. Ho, Henry Shu-Hung Chung, and S. Y. Ron Hui, "A comparative study of maximum power point trackers for photovoltaic panels using switching frequency modulation scheme", *IEEE Transactions on Industrial Electronics*, Vol.51, No.2, April 2004, pp. 410-418.
- [15] Trishan Eswam and Patrick L. Chapman, "Comparison of Photovoltaic Array Maximum Power Point Tracking Techniques", *IEEE Transactions on Energy Conversion*, Vol.22, No.2, June 2007, pp. 439-449.